


Creative Sensor Technology

WIRING DIAGRAM

Southwyck #3 - 2 controllers sharing 1 FS/MV using Pathways. Power for Isoflow from Pathway FM Network.
12/07/15 drawn by NB/AA

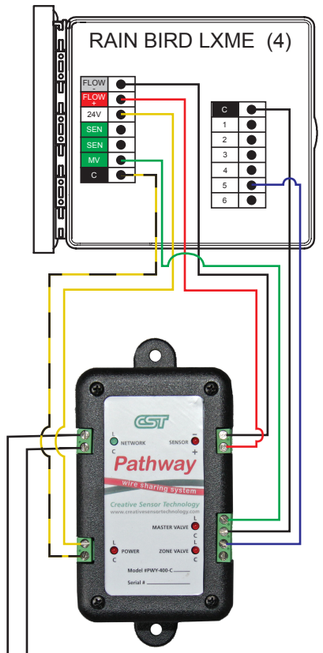

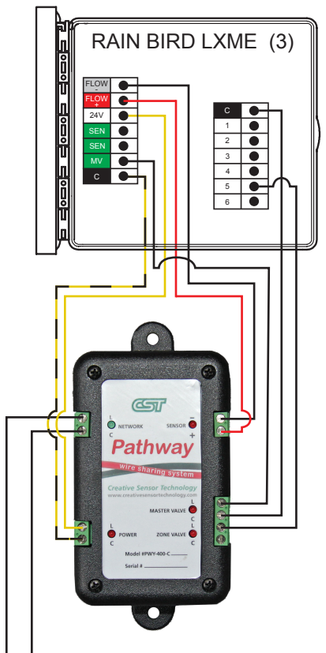

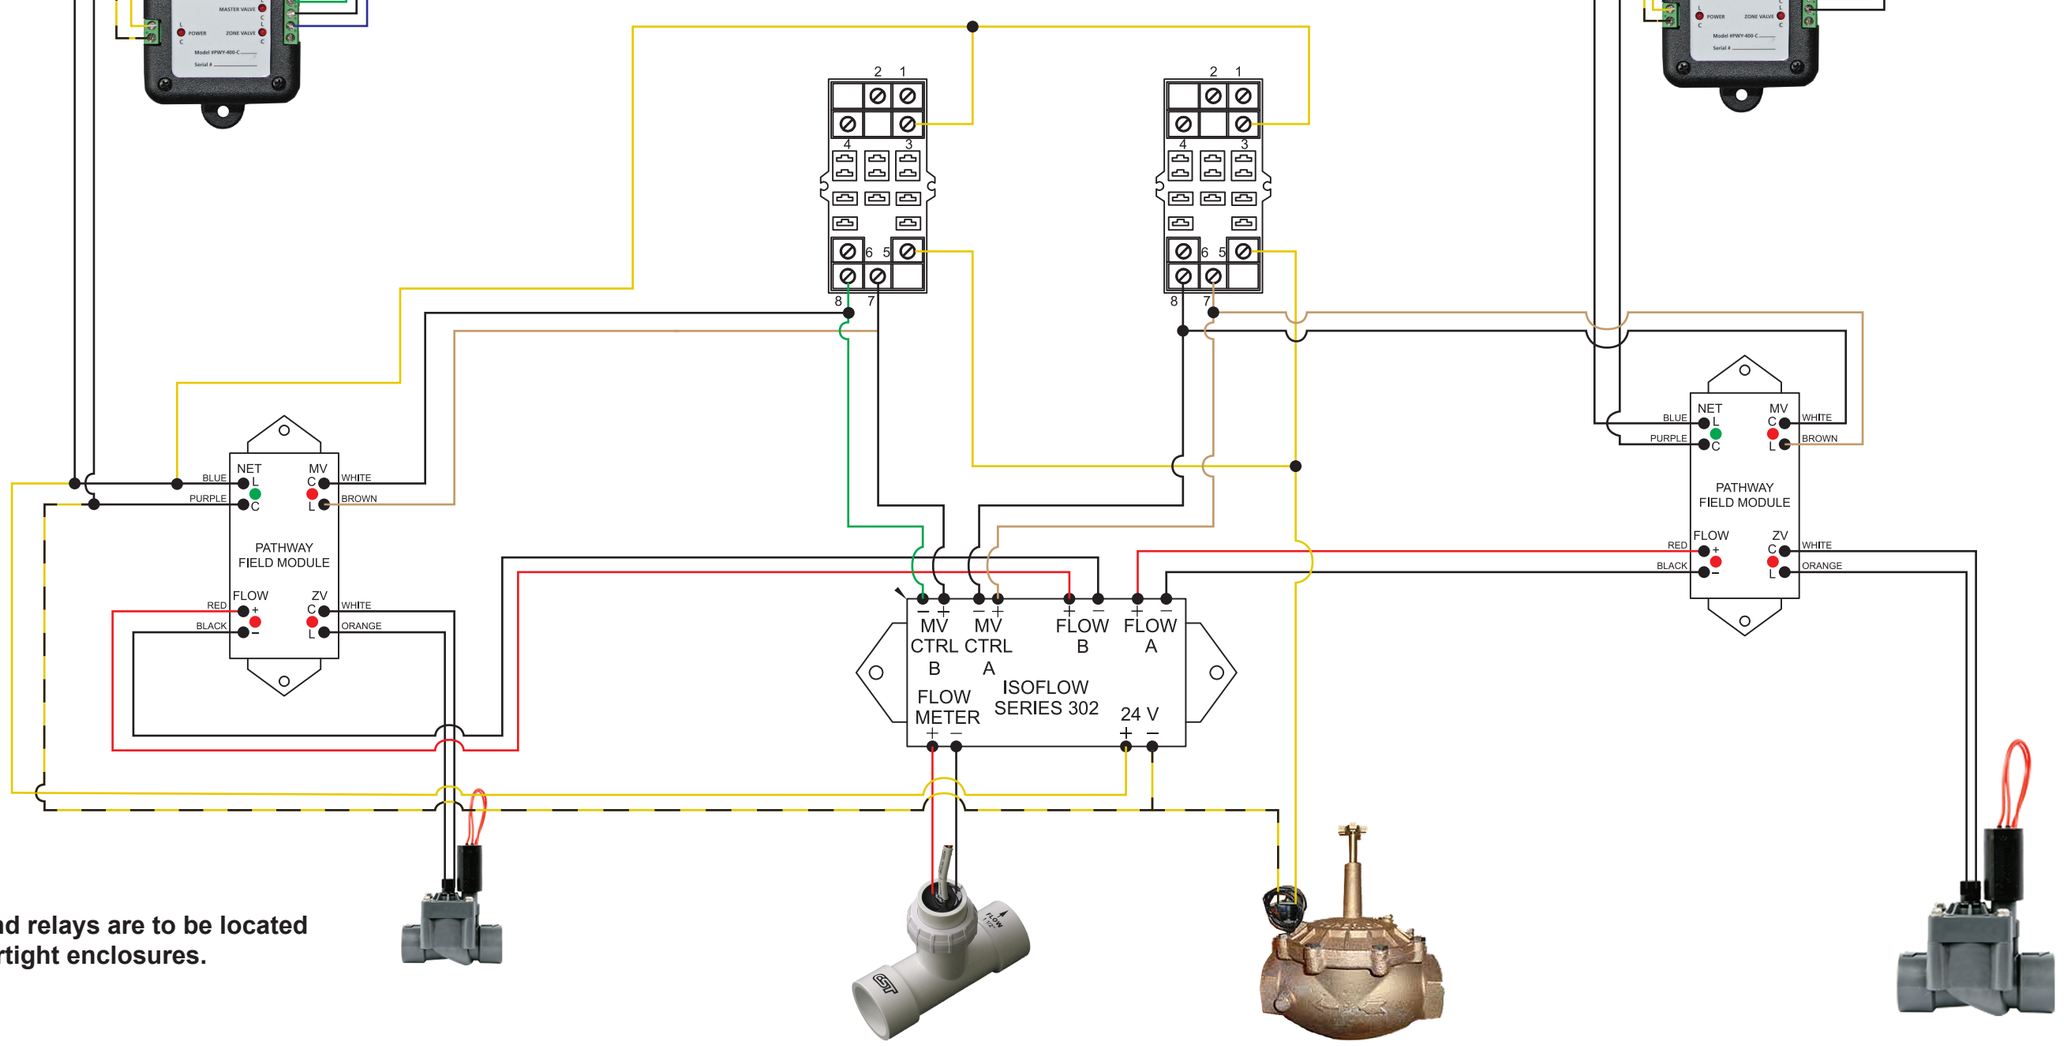



NOTE: Isoflow and relays are to be located at FS/MV in watertight enclosures.

Creative Sensor Technology

WIRING DIAGRAM

Southwyck controller 4
11/24/15 drawn by NB/AA

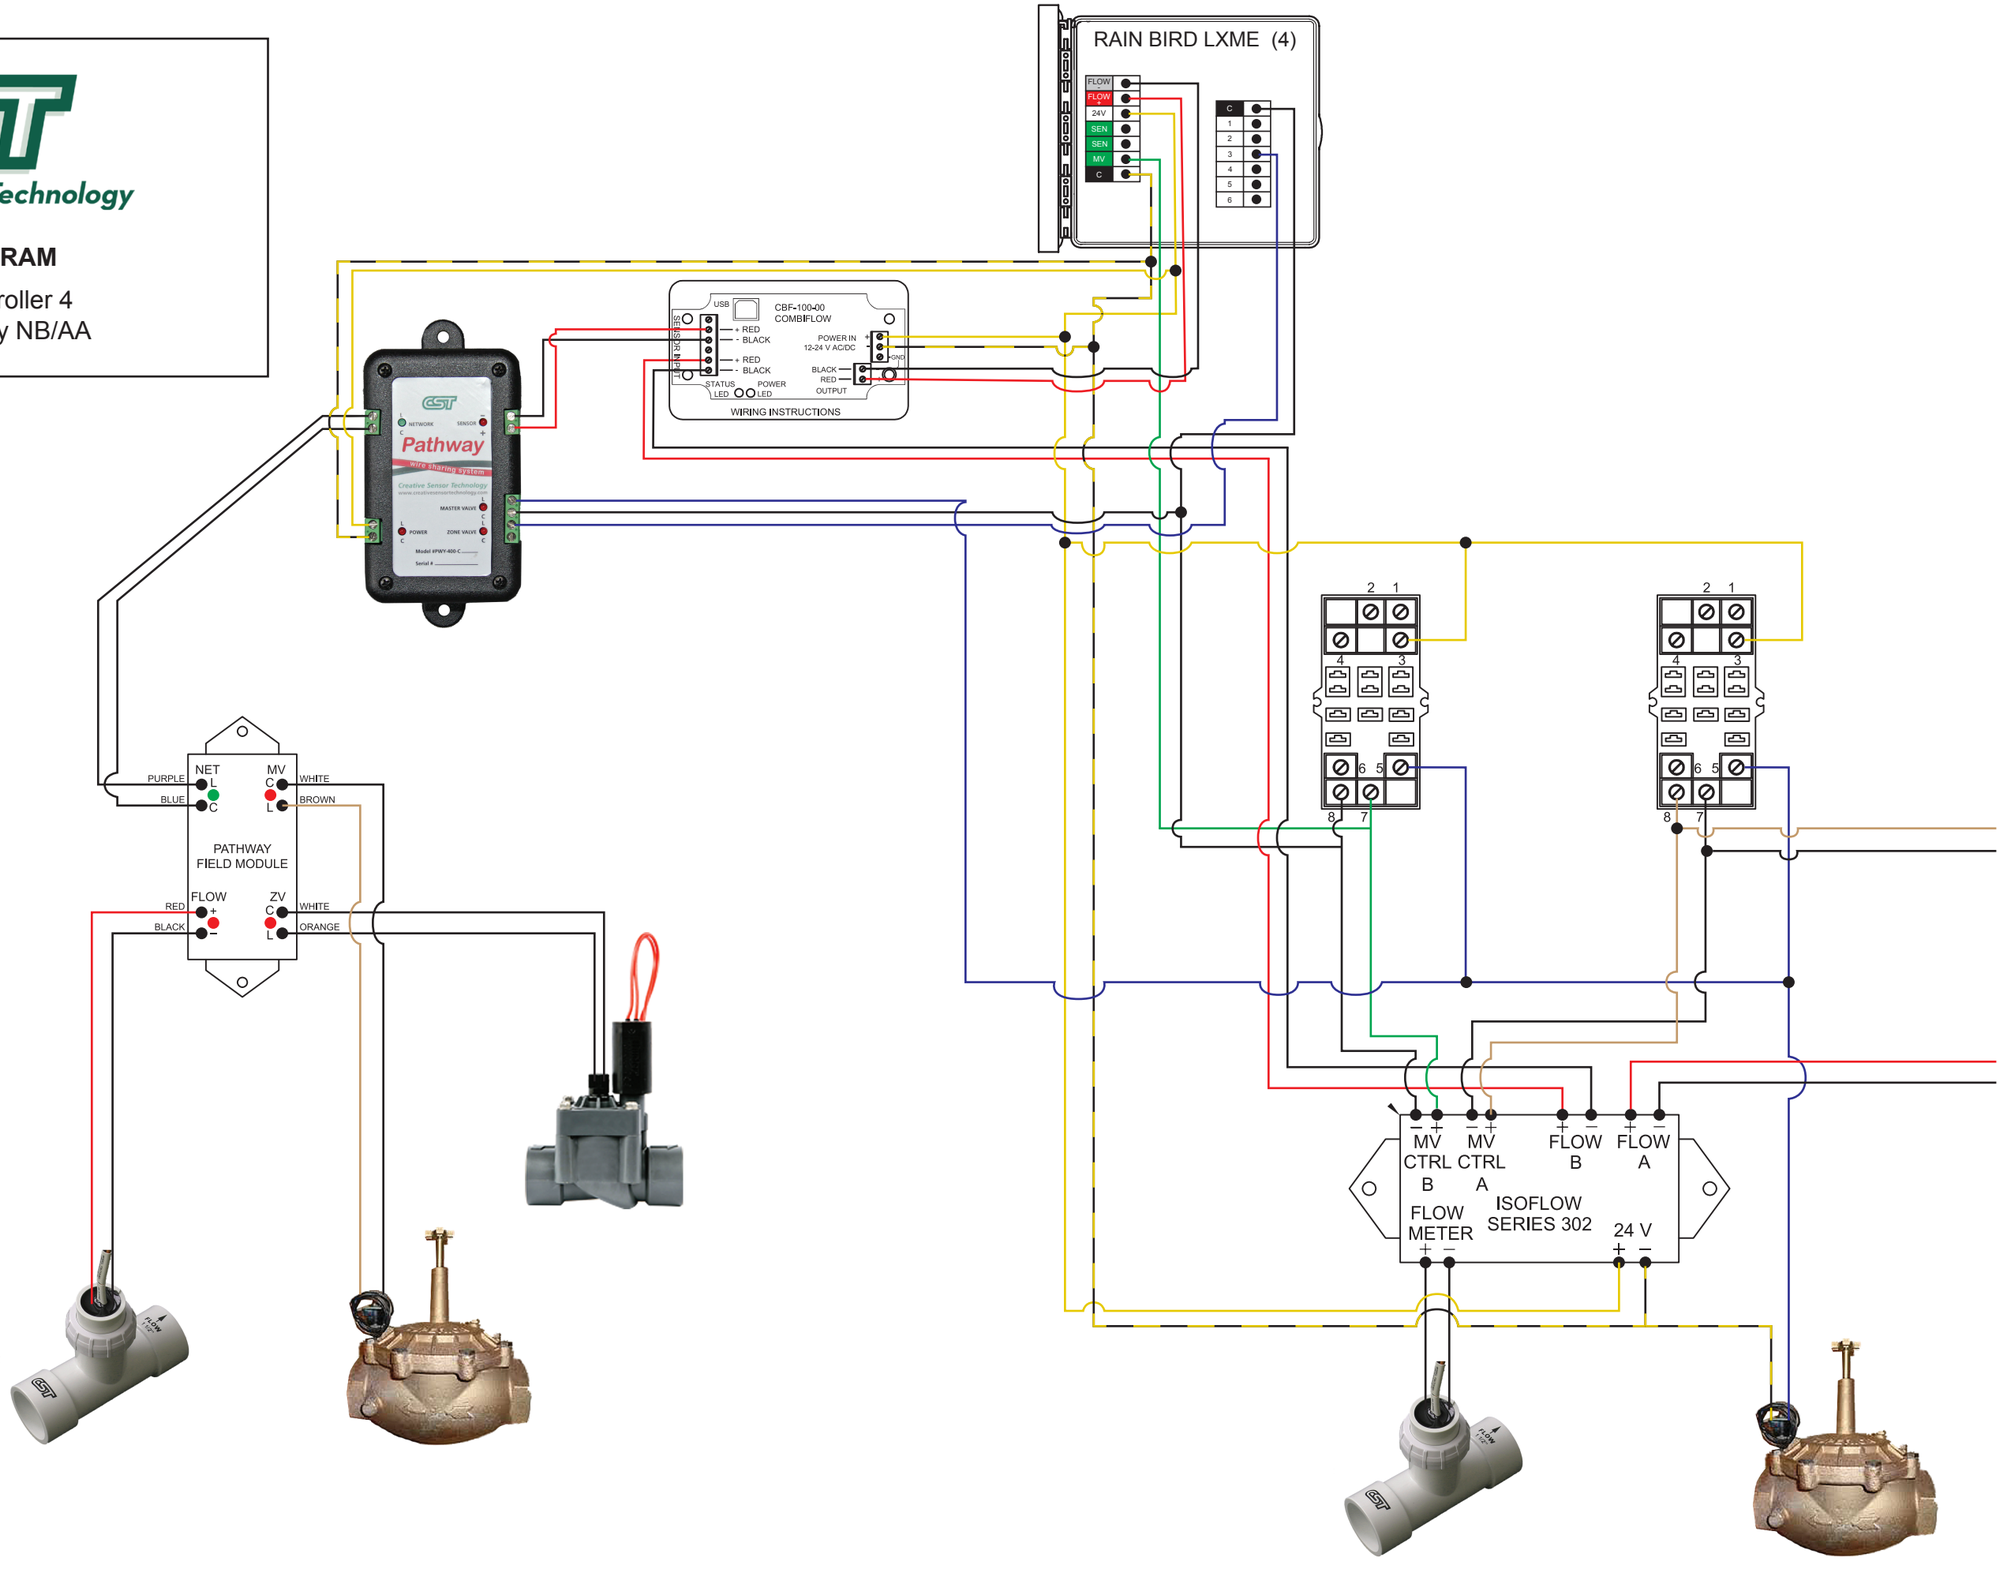

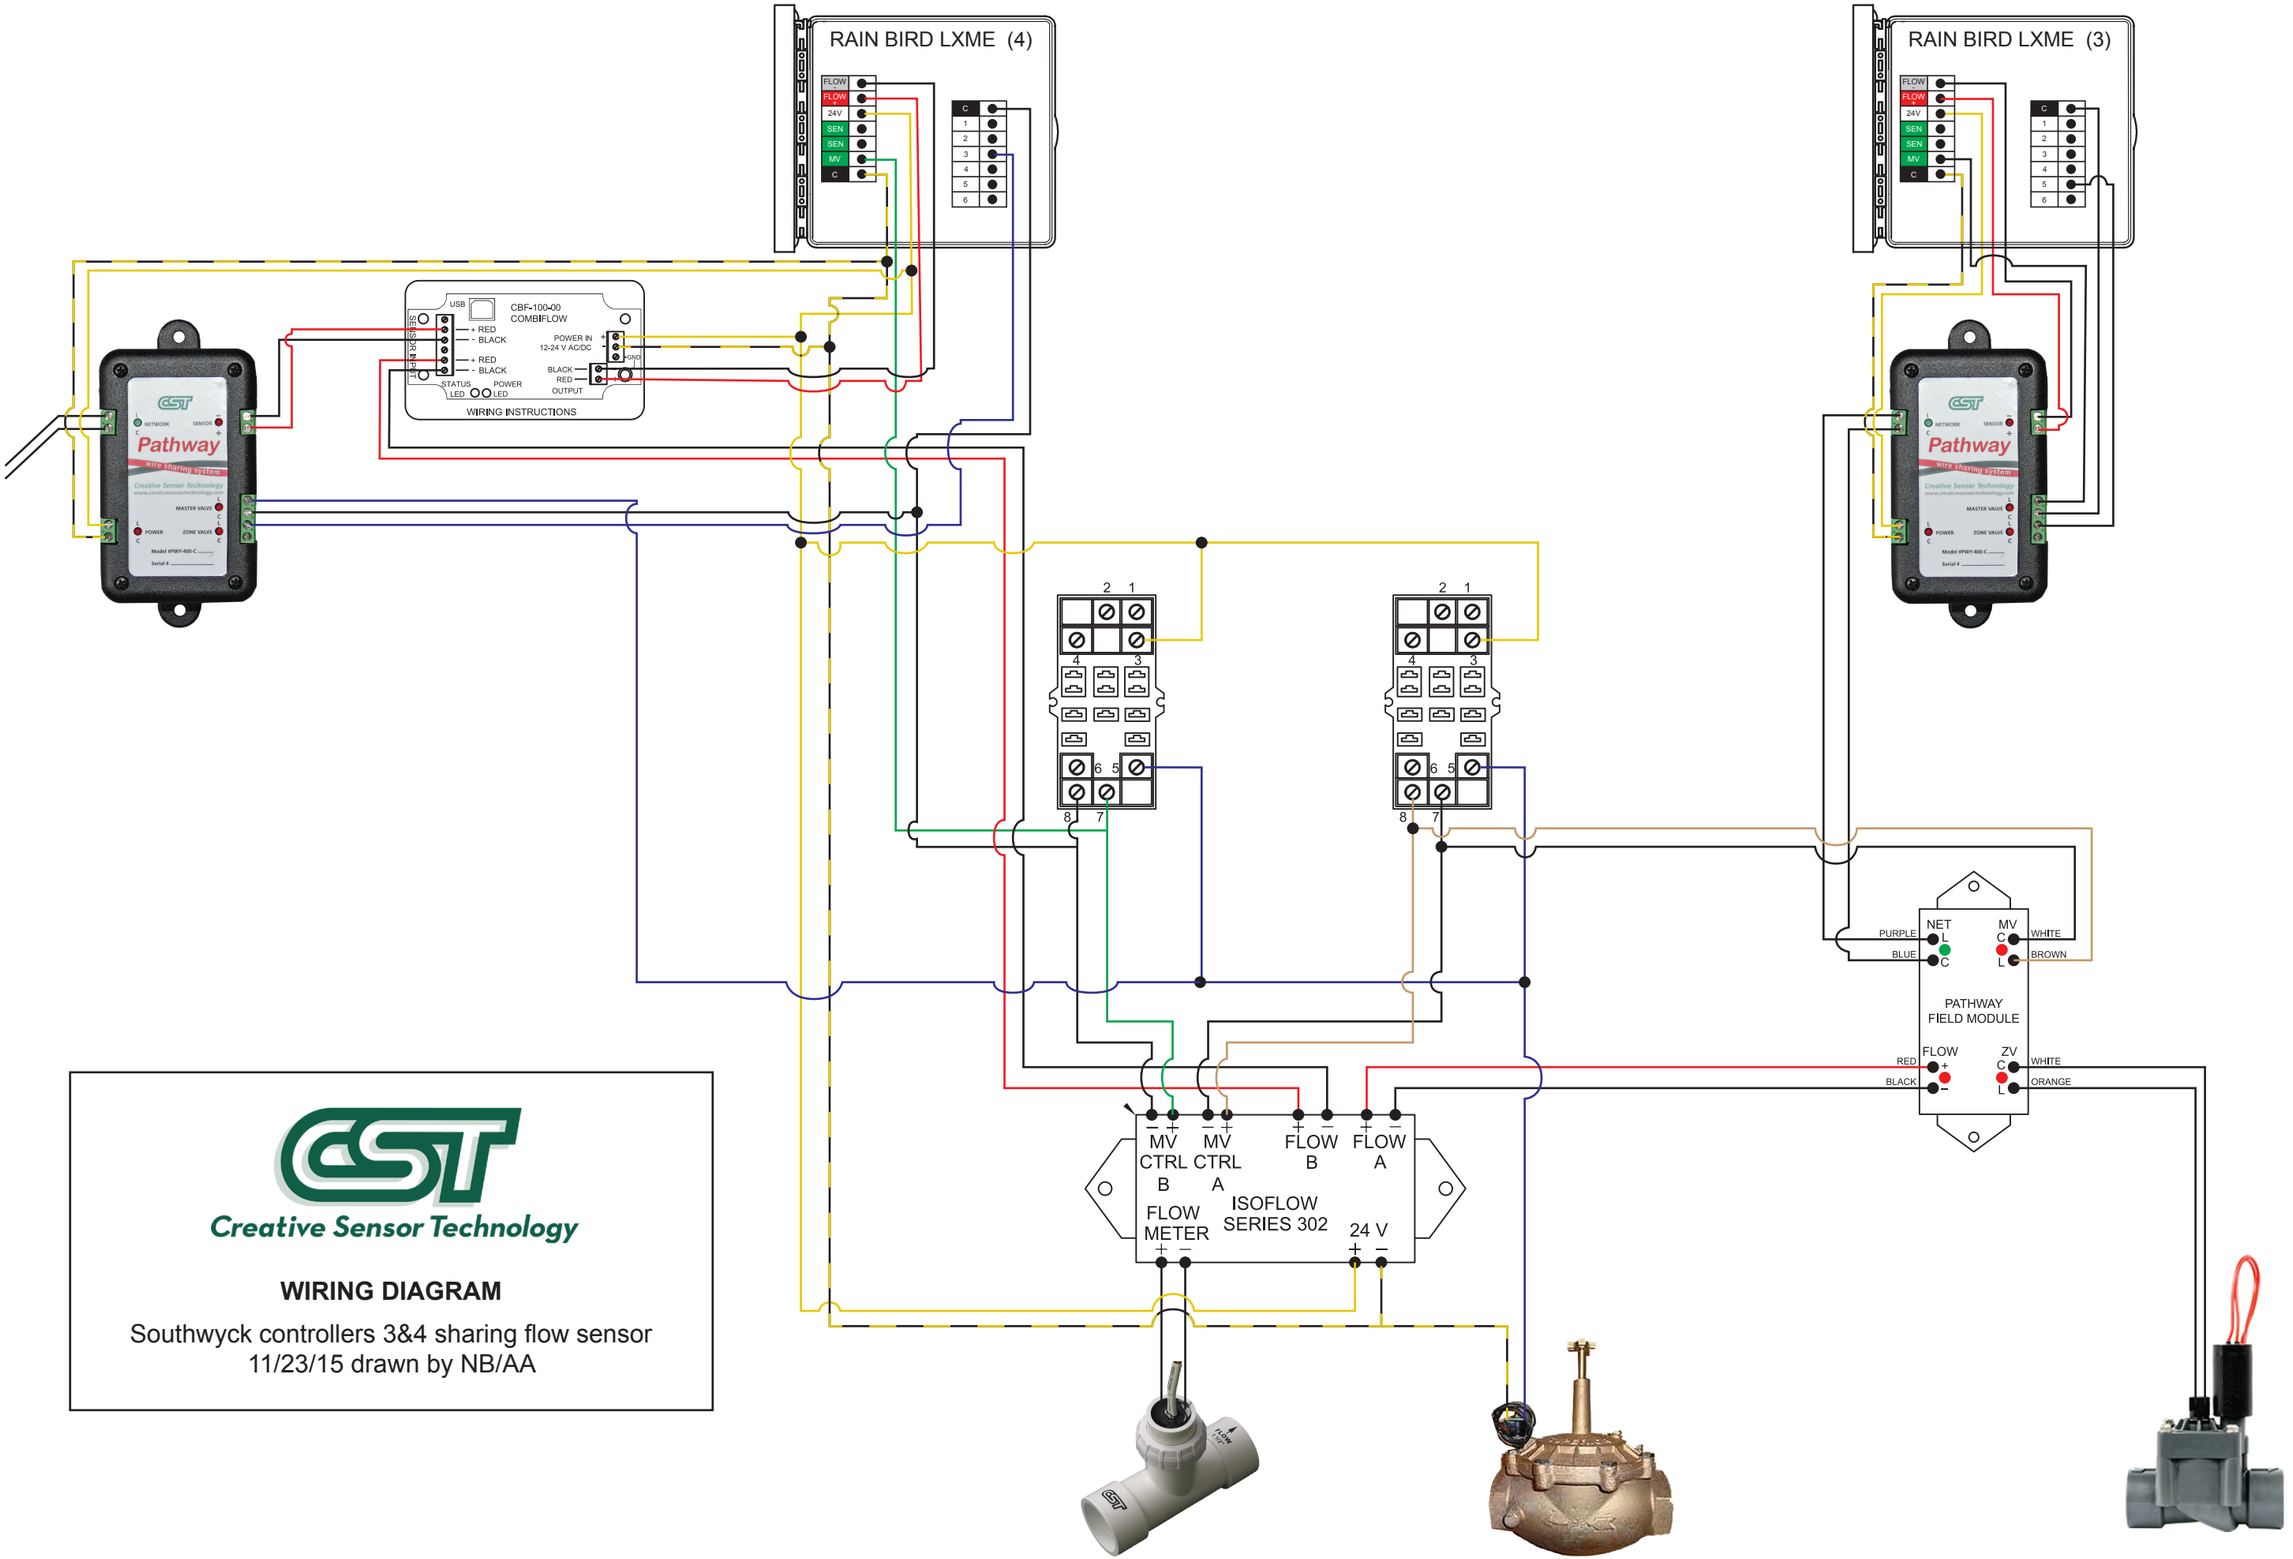

Creative Sensor Technology

WIRING DIAGRAM

Southwyck controllers 3&4 sharing flow sensor
11/23/15 drawn by NB/AA